



THIS INFORMATION IS CONFIDENTIAL AND THE PROPERTY OF SIRIUS. IT IS RELEASED ON CONDITION THAT NONE OF THE INFORMATION SHALL BE DISCLOSED TO ANY THIRD PARTY OR REPRODUCED IN WHOLE OR PART WITHOUT THE PRIOR CONSENT IN WRITING OF SIRIUS.

- KEY**
- EXISTING HV OH CABLES
  - EXISTING POST AND WIRE FENCE
  - EXISTING HEDGES
  - EXISTING TREES
  - EXISTING GROUND CONTOURS
  - PROPOSED SUBSTATION AND BESS COMPOUND PLATFORM CONTOURS
  - PROPOSED PALISADE SECURITY FENCE
  - PROPOSED ACoustic FENCE
  - PROPOSED PERIMETER DEER FENCE
  - PROPOSED ACCESS TRACK
  - PROPOSED GRAVELLED AREA
  - PROPOSED SOLAR PANELS
  - PROPOSED INVERTERS
  - BATTERY/INVERTER/TRANSFORMER BAY WITH 3m HIGH CONCRETE FIREWALLS
  - SPARES/STORAGE CABIN
  - CONTAINERS
  - SOLAR AND BESS DNO SUBSTATIONS
  - SOLAR AND BESS SWITCHGEAR CABINS
  - 132kV SUBSTATION
  - POINT OF CONNECTION TO EXISTING PYLON

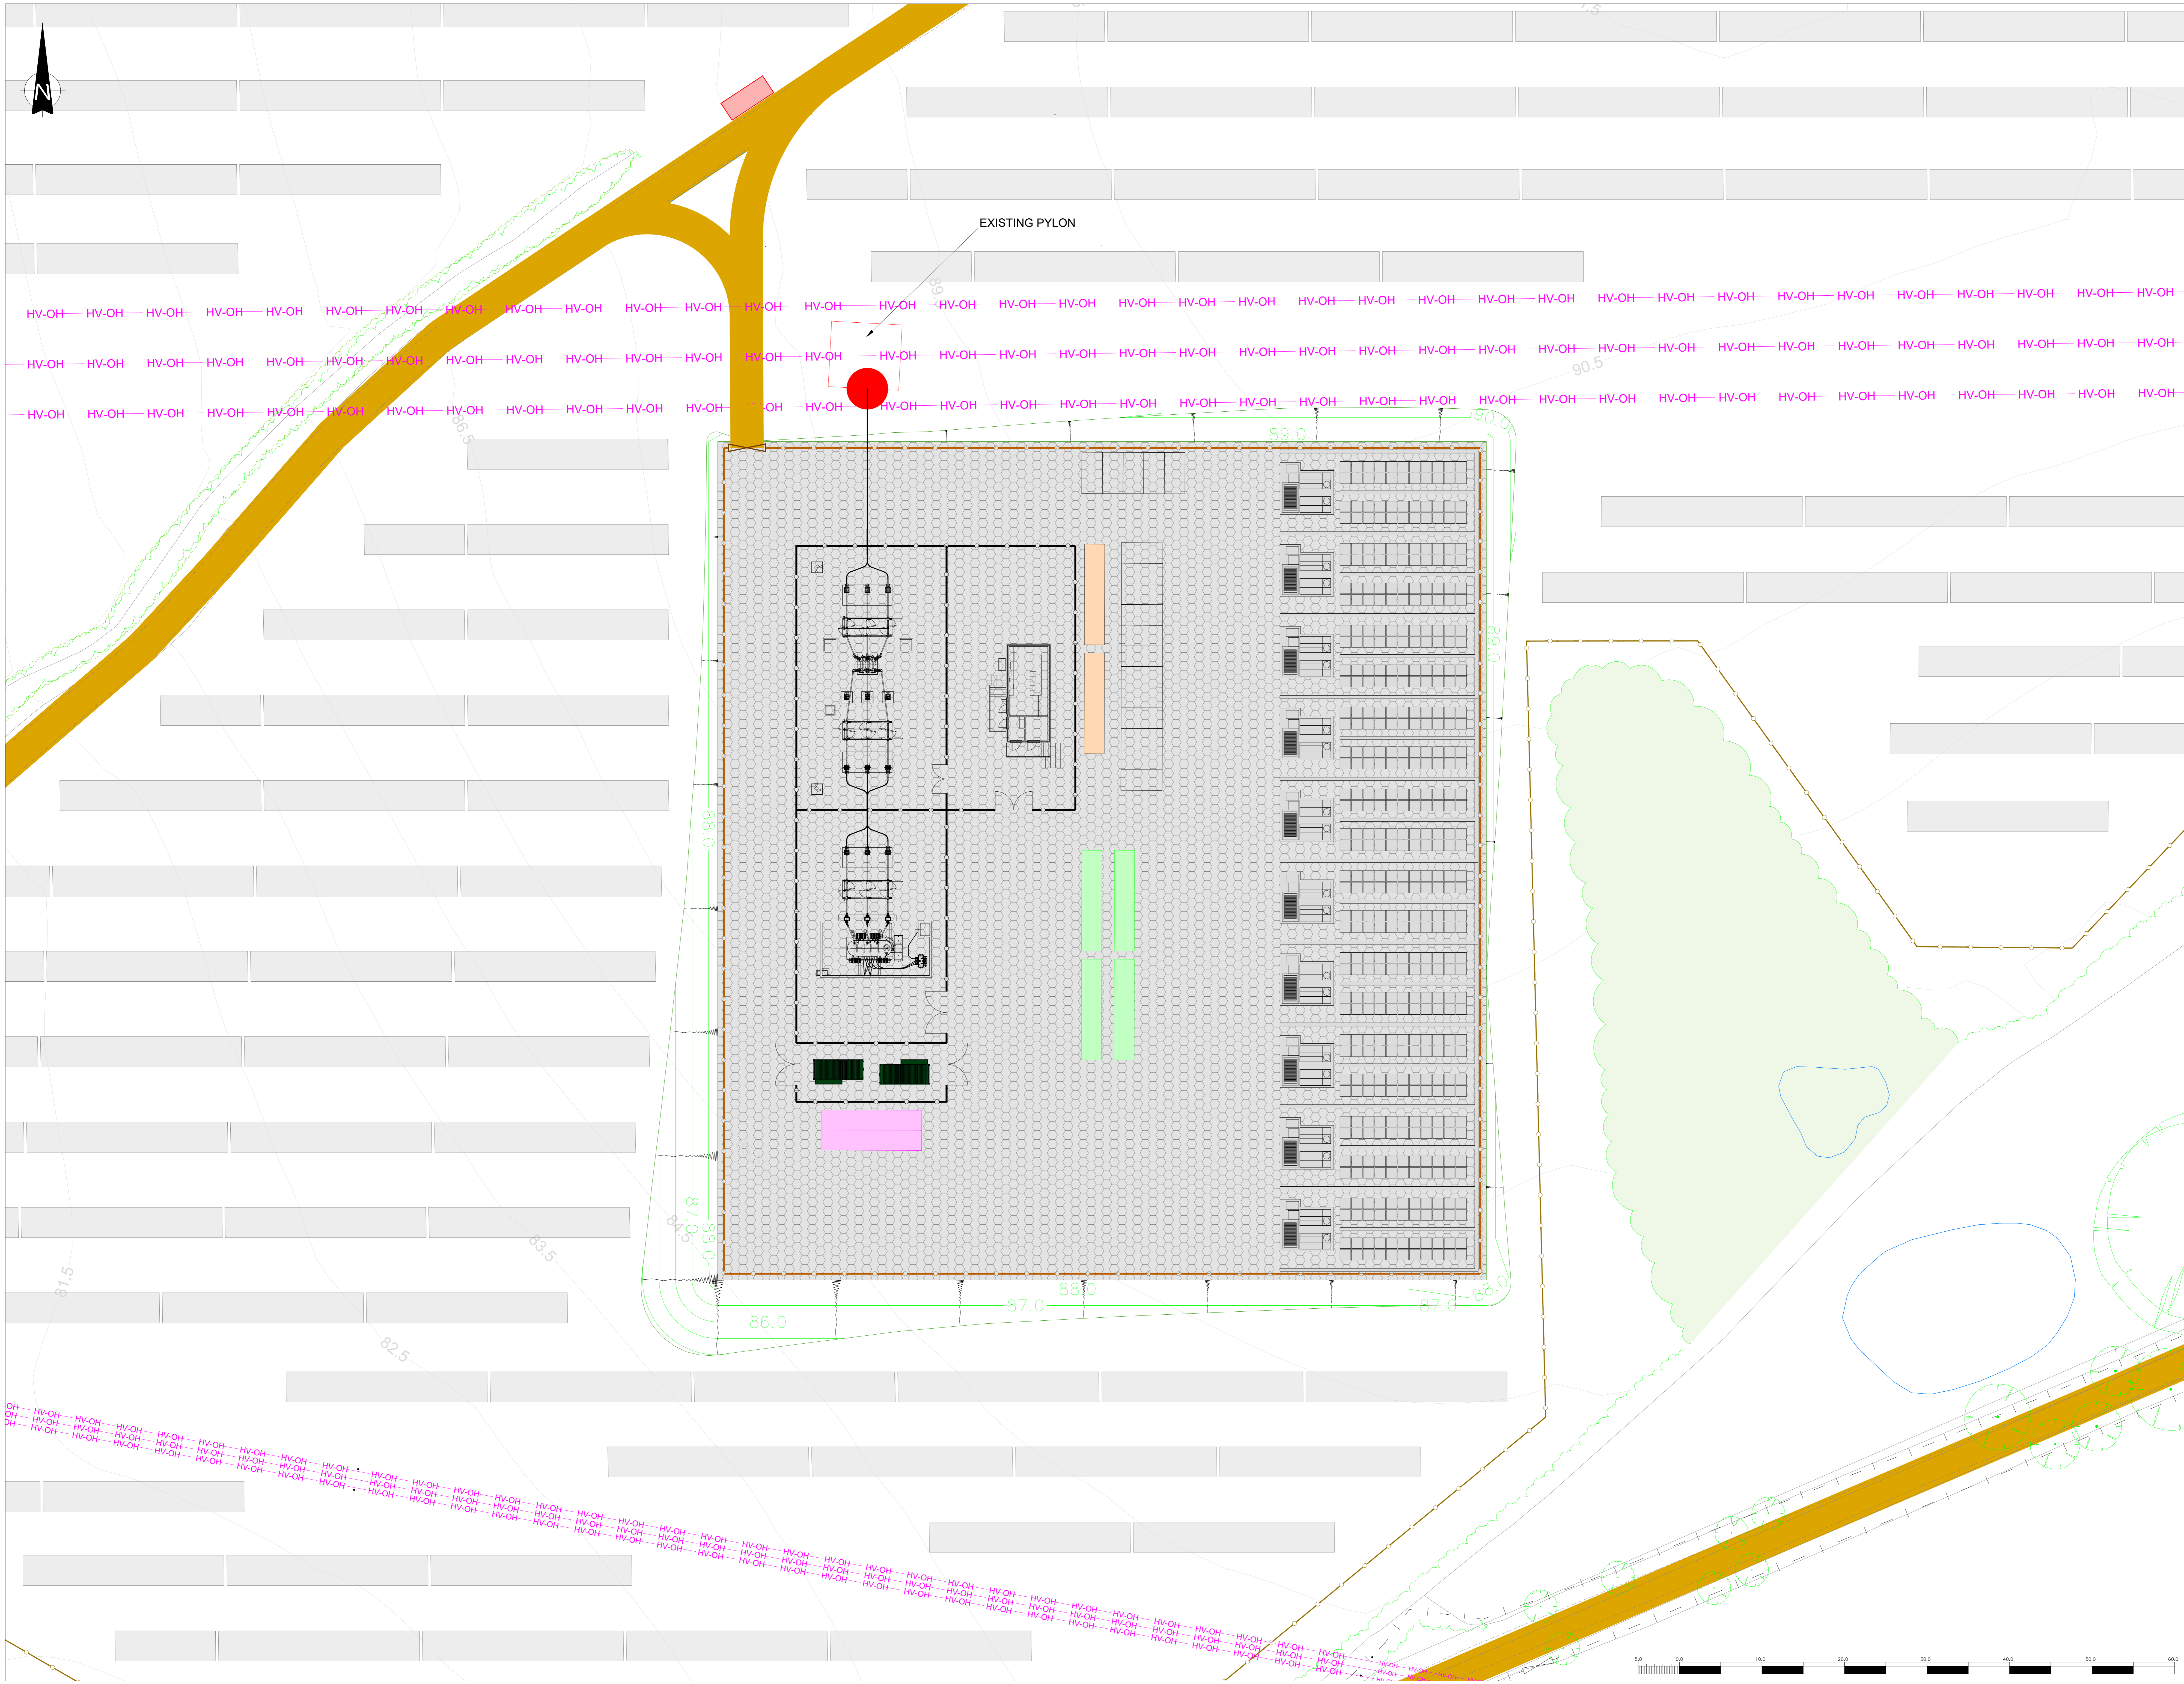

REV	DESCRIPTION	DATE	BY

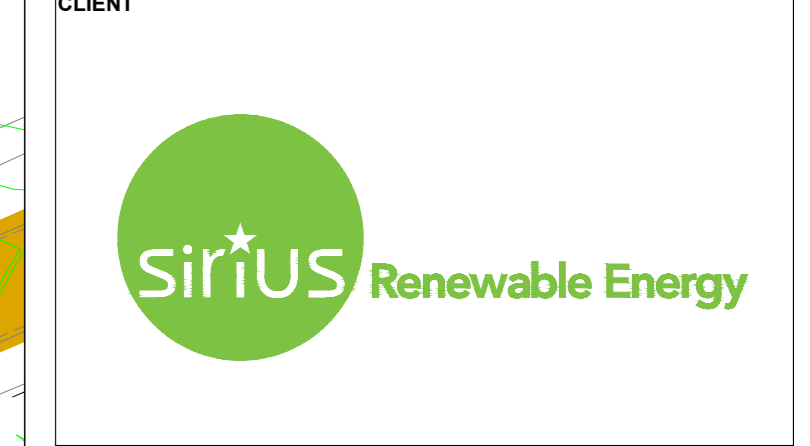

JOB TITLE  
OAKLANDS SOLAR FARM AND BATTERY STORAGE

DRAWING TITLE  
SUBSTATION AND BESS COMPOUND ARRANGEMENT

DRAWN	DATE	APPROVED	DATE
S.T	10/4/2017	J.C	1/9/2022

SCALE	SHEET	DRAWING NUMBER	REVISION
1:250	A0L	SRE1113/02/04	0

